Alternator ref. Alternator type KH00500T KH00500TO4N



## -GENERAL CHARACTERISTICS-

Voltage Type (V)	230 Mono	Altitude (m)	0-1000
Number of Phase	Single phase	AVR Regulation	Yes
Number of pole	4	Indication of protection	IP23
Capacity for maintaining short circuit at 3 In for 10 s Winding type		Yes Standard	

# Efficiency & Power

Frequency (Hz)

50 Hz

Nominal voltage (V)

230

	Class H			Class F	Class B	
	125°C/ 40°C continuous	130°C/ 25°C standby	150°C/ 40°C standby	163°C/ 27°C standby	105°C/ 40°C continuous	80°C/ 40°C continuous
Nominal Rating(Kva)	27		29	30	26	22
Nominal Rating(KW)	27		29	30	26	22
Efficiency 100%	83.3		83	82.9	83.4	83.6

## -ELECTRICAL CHARACTERISTICS-

Voltage regulation at established rating (+/- %)	1
Insulation class	± H
T° class (H/125°), continuous 40°C	H / 125°K
T° class (H/163°C), standby 27°C	H / 163°K
Wave form : NEMA=TIF	<45
Unbalanced load acceptance ratio (%) Number of wires	100
	12
Total Harmonic Distortion in no-load DHT (%)	30
Wave form : CEI=FHT	<2
Total Harmonic Distortion, on linear load DHT (%)	16
Technology	Brushless
L-L Harmonic Maximum - Single (%)	<3
Deviation Factor (%)	6
Shaft Current	<80
Main Stator Capacitance to ground (mdf)	
<u>Reactances</u>	
Direct axis synchro reactance unsaturated (Xd) (%)	211.7
Direct axis transcient reactance saturated (X'd) (%)	16.8
Direct axis subtranscient reactance saturated (X"d) (%)	12.6
Quadra axis synchro reactance unsaturated (Xq) (%)	68.9
Quadra axis subtranscient reactance saturated (X"q) (%)	36.1
Zero sequence reactance unsaturated (Xo) (%)	1.9
Negative sequence reactance saturated (X2) (%)	27
Short circuit ratio	
Short circuit ratio (Kcc)	0.55

3.351411E+10-B

The generator set manufacturer reserves the right to change the design or specifications without notice and without any obligation or liability whatsoever

Alternator ref.	KH00500T
Alternator type	KH00500TO4N

KOHLER
--------

Subtranscient time constant (T"d) (ms)	14
Short circuit transcient time constant (T'd) (ms)	58
Open circuit time constant (T'do) (ms)	1280
Subtranscient time constant (T"q) (ms)	13
Leakage stator reactance (Xa)(%)	5.2
Stator Resistance (Ra)(%)	0.051
Armature time constant (Ta) (ms)	30
No load excitation current (io) (A)	0.83
Full load excitation current (ic) (A)	3.3
Full load excitation voltage (uc) (V)	35.2
Heat rejection (W)	5413
No load losses (W)	935
Stator resistance (for 20°C ambient ) (Ω)	0.065
Rotor resistance (for 20°C ambient ) (Ω)	2.171
Exciter resistance - stator/inductor (for 20° ambient ) (Ω)	10.6
Exciter resistance - rotor/armature (for 20° ambient ) (Ω)	0.417
Recovery time (Delta U = 20% transcient) (ms)	200
Engine start (Delta U = 20% perm. or 30% trans.) (kVA)	87.7
Transcient dip (4/4 load) - PF : 0,8 AR (%)	12.6

## Additional electrical characteristics-

Winding X1, X2 auxiliary resistance (for 20° ambient ) ( $\Omega$ )	1.061
Auxiliary winding X1, X2 excitation voltage at no load (V)	199
Auxiliary winding X1, X2 excitation voltage on load (V)	218
Winding Z1, Z2 auxiliary resistance (for 20° ambient ) ( $\Omega$ )	
Auxiliary winding Z1, Z2 excitation voltage at no load (V)	

## -MECHANICAL CHARACTERISTICS-

Number of bearing	1
Overspeed (rpm)	2250
Coupling	Direct


3.351411E+10-B

The generator set manufacturer reserves the right to change the design or specifications without notice and without any obligation or liability whatsoever




## -TECHNICAL CURVES-

#### Motor starting curve locked rotor (0,6PF)

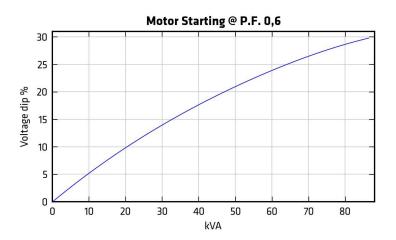

#### Motor starting curve locked rotor (0,3PF)

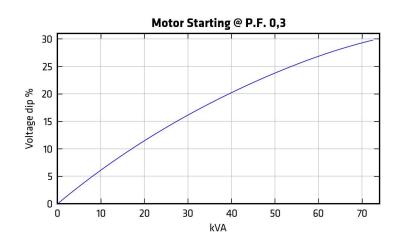


Alternator ref. Alternator type KH00500T KH00500TO4N



#### Efficiencies curve (by excitation system)



#### Loading curve (by excitation system)

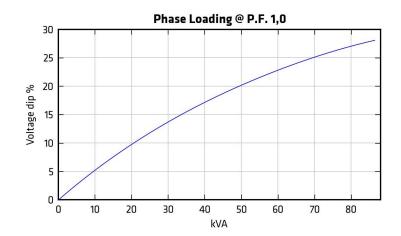

Alternator ref. Alternator type KH00500T KH00500TO4N



Short circuit curve at no load and rated speed

#### Influence due to connection

Curves shown are for star (Y) connection For other connections, use the following multiplication factors :

- Series to Parallel star : current value x 2
- Series to Series delta : current value x 1.72
- Series star to Parallel delta : current value x 3.44

#### Influence due to short-circuit

The indicated coefficient have to be used to correct the three phase short circuit curves values as a function of the type of short circuit voltage.

## DATASHEET ALTERNATOR Alternator ref.

Alternator type


KH00500T KH00500TO4N



#### **Rejection curve (by excitation system)**



#### **Capability curve (PQ diagram)**

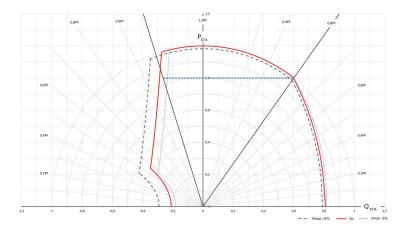


3.351411E+10-B The generator set manufacturer reserves the right to change the design or specifications without notice and without any obligation or liability whatsoever Alternator ref. Alternator type KH00500T KH00500TO4N



## DIMENSIONS-


**Overall dimension drawing (Single bearing)** 

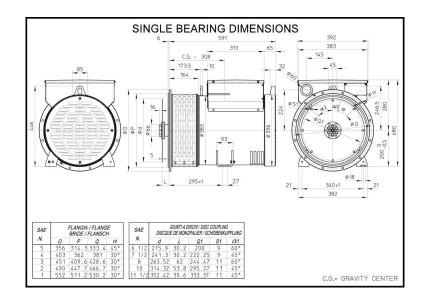

Alternator ref. Alternator type KH00500T KH00500TO4N



#### **Overall dimension drawing (Two bearings)**

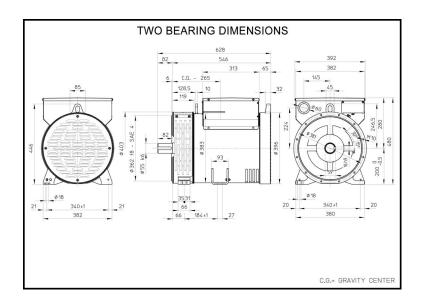


Alternator ref. Alternator type KH00500T KH00500TO4N



## -TORSIONAL ANALYSIS DATA-

#### Rotation part drawing for torsional vibration calculation (Single bearing)

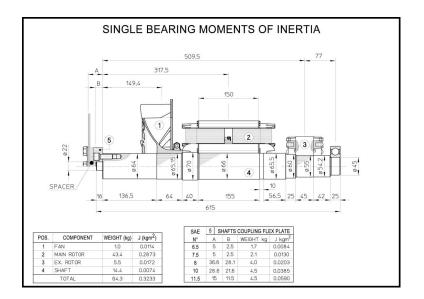

Alternator ref. Alternator type KH00500T KH00500TO4N



#### Rotation part drawing for torsional vibration calculation (Two bearings)

